

AIR HANDLING BY S&P


S&P UK offers an extensive range of air handling units for many applications.

With our specialist support, we're on hand to deliver the assistance you need, no matter the size or complexity of your project




APPLICATIONS

S&P UK offers an extensive range of air handling units to meet your needs, with airflows ranging all the way from 20 l/s up to 4 m³/s.

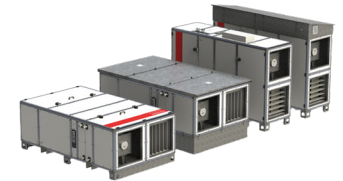

20 l/s — 130 l/s — 0.05 m³/s — 4 m³/s

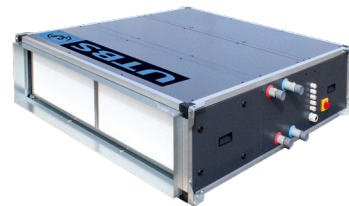

- Offices • Retail • Education • Leisure Facilities • Public Buildings
- Research Laboratories • Food Service • Warehouses • Hotels • Factories

CAD EPP

Residential or commercial MVHR unit complete with high efficiency counterflow heat exchanger

From 30 l/s

up to 80 l/s

- EPP Lightweight Design
- Wireless Control
- Horizontal or Vertical Installation



SABIK

Residential MVHR units complete with high efficiency counterflow heat exchanger

From 20 l/s

up to 130 l/s

- Passive House Certified
- Plug & Play Controls
- Airflow Direction Handing by Installer
- Optional Bottom Connections for Straight Through Installations



AIR
HANDLING



HEAT
RECOVERY



INLINE
DUCT



ACOUSTIC
FANS

CAIB/T

Packaged supply air handling unit with multiple heating and cooling options

From 0.055 m³/s

up to 5.5 m³/s

- Multiple Heating & Cooling Options
- Plug & Play Controls
- Double Skinned 50mm Panel
- Controls link to Extract Fan




UTBS

Supply air handling unit with multiple heating, cooling and filtration options

From 0.3 m³/s

up to 1.6 m³/s

- Multiple Heating & Cooling Options
- Plug & Play Controls
- Low Profile

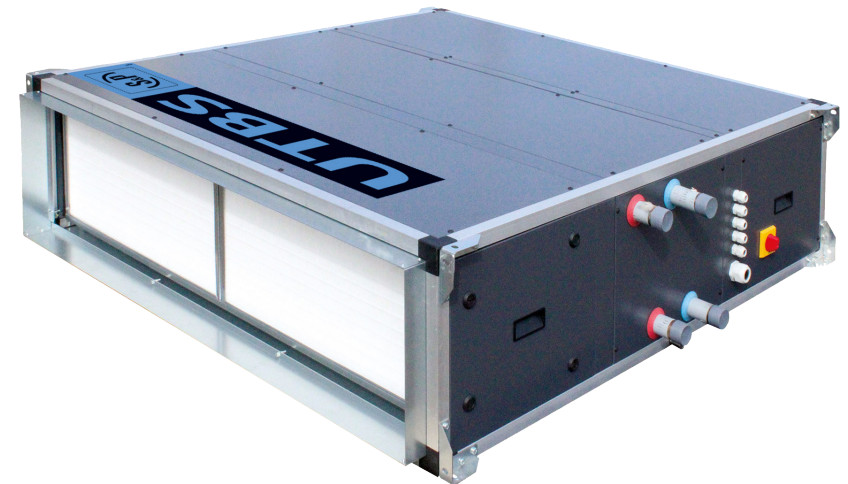

CAD COMPACT

Commercial heat recovery unit complete with high efficiency Eurovent certified counterflow heat exchanger

From 0.055 m³/s

up to 1.25 m³/s

- Small Footprint, Compact Design
- Plug & Play Controls
- Airflow Direction Handing by Installer



CADB/T-HE

Commercial heat recovery unit complete with high efficiency Eurovent certified counterflow heat exchanger

From 0.135 m³/s

up to 2.7 m³/s

- Configurable Spigot Panels, Adaptable Design
- Plug & Play Controls
- Horizontal or Stacked Configuration



AIR
HANDLING



HEAT
RECOVERY



INLINE
DUCT



ACOUSTIC
FANS

SLIM

Commercial heat recovery unit complete with high efficiency Eurovent certified counterflow heat exchanger

From 0.22 m³/s

up to 0.67 m³/s

- Low Profile, Slim Design
- Plug & Play Controls
- Integrated Condensate Pump
- Sliding Access Doors



RHE

Commercial heat recovery unit complete with Eurovent certified high efficiency thermal wheel heat exchanger

From 0.22 m³/s

up to 4.1 m³/s

- Low Sound, Double Skinned 50mm Panels
- Compact Design
- Plug & Play Controls
- Vertical or Horizontal Configuration





DUOVENT COMPACT/MODULAR

Commercial heat recovery with both Eurovent certified thermal wheel and counterflow exchanger options

From 0.14 m³/s

up to 4 m³/s

- Low Sound, Double Skinned 45mm Panels
- Compact Design
- Plug & Play Controls
- Vertical, Horizontal, or Stacked Configuration

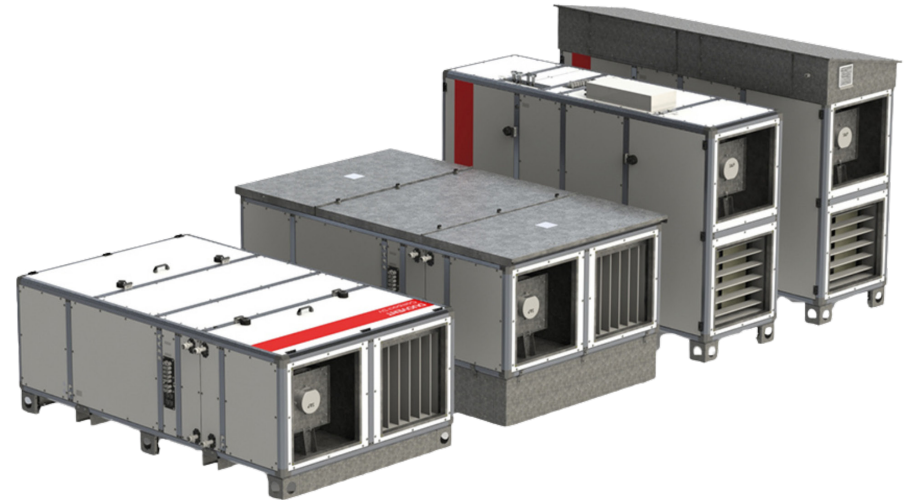

NBS Source is a tool that offers a single source for product information. Unlike any other product library, NBS Source provides an additional level of enhanced product data, in a consistent, structured format that will integrate seamlessly into your project workflow.



AIR
HANDLING



HEAT
RECOVERY



INLINE
DUCT



ACOUSTIC
FANS

Good to Know: Building Regulations Part L Mechanical Ventilation L1(b), L2 - Residential

6.55 The specific fan power for mechanical ventilation systems should not exceed the following:

d. For continuous mechanical supply and extract ventilation systems: 1.5W/(l-s).

6.56 All ventilation systems which provide both supply and extract ventilation within the same unit should be fitted with all of the following:

a. A heat recovery system with a minimum efficiency of 73%.

b. A summer bypass facility (giving the ability to bypass the heat exchanger or to control its heat recovery performance).

c. A variable speed controller.

System Type	SFP (W/(l-s))	
	New Buildings	Existing Buildings
Central balanced mechanical ventilation system with heating & cooling	2.0	2.6
Central balanced mechanical ventilation system with heating only	1.9	2.2
All other central balanced mechanical ventilation systems	1.5	2.0
Zonal supply system where fan is remote from zone eg ceiling void/roof units	1.1	1.4
Zonal balanced supply and extract ventilation units, eg ceiling void/ roof units	2.3	2.3
Local balanced supply and extract ventilation system, eg wall/roof units	2.0	2.0

NOTES:

1. A central system is one which serves the whole or major areas of the building. A zonal system is one which serves a group of rooms or areas in part of the building and requires ducting. A local system or unit is one which serves a single room or area and does not require ducting.

2. For balanced supply and extract systems, the minimum SFP includes an allowance for heat recovery and return filter.

Good to Know: Eurovent 4/23 - 2022

'Selection of EN ISO 16890 rated air filter classes for general ventilation applications':



OUTDOOR AIR CATEGORIES

CATEGORY	DESCRIPTION
ODA 1	OUTDOOR AIR, WHICH MAY ONLY BE TEMPORARILY DUSTY Applies where the World Health Organisation WHO (2021) guidelines are fulfilled (annual mean for PM _{2,5} ≤ 5 µg/m ³ and PM ₁₀ ≤ 15 µg/m ³).
ODA 2	OUTDOOR AIR WITH HIGH CONCENTRATIONS OF PARTICULATE MATTER Applies where PM concentrations exceed the WHO guidelines by a factor of up to 1,5 (annual mean for PM _{2,5} ≤ 7,5 µg/m ³ and PM ₁₀ ≤ 22,5 µg/m ³).
ODA 3	OUTDOOR AIR WITH VERY HIGH CONCENTRATIONS OF PARTICULATE MATTER Applies where PM concentrations exceed the WHO guidelines by a factor of greater than 1,5 (annual mean for PM _{2,5} >7,5 µg/m ³ and PM ₁₀ >22,5 µg/m ³).

SUPPLY AIR CATEGORIES

CATEGORY	DESCRIPTION
SUP 1	Refers to supply air with concentrations of particulate matter which fulfilled the WHO (2021) guidelines limit values multiplied by a factor x 0,25 (annual mean for PM _{2,5} ≤ 1,25 µg/m ³ and PM ₁₀ ≤ 3,75 µg/m ³).
SUP 2	Refers to supply air with concentrations of particulate matter which fulfilled the WHO (2021) guidelines limit values multiplied by a factor x 0,5 (annual mean for PM _{2,5} ≤ 2,5 µg/m ³ and PM ₁₀ ≤ 7,5 µg/m ³).
SUP 3	Refers to supply air with concentrations of particulate matter which fulfilled the WHO (2021) guidelines limit values multiplied by a factor x 0,75 (annual mean for PM _{2,5} ≤ 3,75 µg/m ³ and PM ₁₀ ≤ 11,25 µg/m ³).
SUP 4	Refers to supply air with concentrations of particulate matter which fulfilled the WHO (2021) guidelines limit values (annual mean for PM _{2,5} ≤ 5 µg/m ³ and PM ₁₀ ≤ 15 µg/m ³).
SUP 5	Refers to supply air with concentrations of particulate matter which fulfilled the WHO (2021) guidelines limit values multiplied by factor x 1,5 (annual mean for PM _{2,5} ≤ 7,5 µg/m ³ and PM ₁₀ ≤ 22,5 µg/m ³).



AIR
HANDLING



HEAT
RECOVERY



INLINE
DUCT



ACOUSTIC
FANS

SUMMARY OF RECOMMENDED MINIMUM EFFICIENCIES DEPENDING ON ODA & SUP:

OUTDOOR AIR			SUPPLY AIR				
			SUP 1* PM2,5 ≤ 1,25 PM10 ≤ 3,75	SUP 2* PM2,5 ≤ 2,5 PM10 ≤ 7,5	SUP 3** PM2,5 ≤ 3,75 PM10 ≤ 11,25	SUP 4 PM2,5 ≤ 5 PM10 ≤ 15	SUP 5 PM2,5 ≤ 7,5 PM10 ≤ 22,5
CATEGORY	PM2,5	PM10	ePM1	ePM1	ePM2,5	ePM10	ePM10
ODA 1	≤ 5	≤ 15	70%	50%	50%	50%	50%
ODA 2	≤ 7,5	≤ 22,5	80%	70%	70%	80%	50%
ODA 3	> 7,5	> 22,5	90%	80%	80%	90%	80%

* Minimum filtration requirements ISO ePM1 50% refer to a final filter stage

** Minimum filtration requirements ISO ePM2,5 50% refer to a final filter stage

ADDITIONAL RECOMMENDATIONS

As the task of air filters in HVAC systems is not only to protect ventilated rooms from too severe level of contamination, but also the HVAC system itself, the minimum efficiency of a first stage filter (on fresh air inlet) should be at least ePM10 50%. Yet, if air humidification is applied in the system, the minimum efficiency of a filter located downstream the humidifier should be at least ePM2,5 65%.

SUPPLY AIR CATEGORIES

CATEGORY	GENERAL VENTILATION
SUP 1	-
SUP 2	Rooms for permanent occupation. Examples: Kindergartens, offices, hotels, residential buildings, meeting rooms, exhibition halls, conference halls, theatres, cinemas, concert halls.
SUP 3	Rooms with temporary occupation. Examples: Storage, shopping centres, washing rooms, server rooms, copier rooms.
SUP 4	Rooms with short-term occupation. Examples: restrooms, storage rooms stairways.
SUP 5	Rooms without occupation. Examples: Garbage room, data centres, underground car parks.

CATEGORY	INDUSTRIAL VENTILATION
SUP 1	Applications with high hygienic demands. Examples: Hospitals, pharmaceuticals, electronic and optical industry, supply air to clean rooms.
SUP 2	Applications with medium hygienic demands. Examples: Food and beverage production.
SUP 3	Applications with basic hygienic demands. Examples: Food and beverages production with a basic hygienic demand.
SUP 4	Applications without hygienic demands. Examples: General production areas in the automotive industry.
SUP 5	Production areas of the heavy industry. Examples: Steel mill, smelters, welding plants.



AIR
HANDLING



HEAT
RECOVERY



INLINE
DUCT



ACOUSTIC
FANS

COMPARISON OF EN 779 AND EN ISO 16890 RATED FILTER CLASSES

EN 779: 2012	EN ISO 16890 – range of actual measured average efficiencies		
Filter Class	ePM1	ePM2,5	ePM10
G4 (Coarse)	Non-Compliant	Non-Compliant	Non-Compliant
M5	5% - 35%	10% - 45%	40% - 70%
M6	10% - 40%	20% - 50%	60% - 80%
F7	40% - 65%	65% - 75%	80% - 90%
F8	65% - 90%	75% - 95%	90% - 100%
F9	80% - 90%	85% - 95%	90% - 100%

Additional Recommendation on Application of Optional Gas Filtration

Following the provisions of EN 16798-3:2017, it is recommended to apply additional gas filters to complement particle filtration for the following combinations of outdoor air quality (gaseous) and supply air quality classes:

OUTDOOR AIR	SUPPLY AIR				
	SUP 1	SUP 2	SUP 3	SUP 4	SUP 5
ODA (G) 1	Recommended	-	-	-	-
ODA (G) 2	Required	Recommended	-	-	-
ODA (G) 3	Required	Required	Recommended	-	-

Functionality	CAD-EPP	SABIK	CAIB/T	UTBS	CAD COMPACT	CADB/T-HE	SLIM	RHE	DUOVENT COMPACT
Main elements									
General Isolator	-	-	●	●	●	●	●	●	●
Pre-wired control panel	●	●	●	●	●	●	●	●	●
User interface	Remote Switch	Basic Touchscreen	Touchscreen	Touchscreen	Touchscreen	Touchscreen	Touchscreen	Touchscreen	Touchscreen
Functionality									
Variable Air Volume (VAV)	⊙	●	●	●	●	●	●	●	●
Constant Air Volume (CAV)	-	-	●	●	⊙	●	●	●	⊙
Constant Operational Pressure (COP)	--	-	⊙	⊙	⊙	⊙	⊙	⊙	⊙
Boost	VAV (VFC)	VAV (VFC)	CAV (VFC)	CAV (VFC)	VAV (VFC)	CAV (VFC)	CAV (VFC)	CAV (VFC)	VAV (VFC)
Remote Enable	● (VFC)	-	● (VFC)	● (VFC)	● (VFC)	● (VFC)	● (VFC)	● (VFC)	● (VFC)
7-Day Time Clock	⊙ (VFC)	-	●	●	●	●	●	●	●
RH Duct Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
CO2 Duct Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
VOC Duct Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
Temperature Duct Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
RH Room Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
CO2 Room Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
VOC Room Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)
Temperature Room Monitoring Speed Modulation	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)	⊙ (VFC & O-10V)

● = Supplied as standard - = Not available ⊙ = Accessory Required



AIR HANDLING

HEAT RECOVERY

INLINE DUCT


ACOUSTIC FANS

Functionality	CAD-EPP	SABIK	CAIB/T	UTBS	CAD COMPACT	CADB/T-HE	SLIM	RHE	DUOVENT COMPACT
Temperature Regulation									
Integrated Temperature Sensors	●	●	●	●	●	●	●	●	●
Anti-Frost Protection	-	●	●	●	●	●	●	●	●
Anti-Frost Water Probe	-	-	●	●	-	●	●	●	●
Hot Water Coil Regulation (0-10V)	-	-	⊙	⊙	⊙	⊙	⊙	⊙	⊙
Reversible Hot/Cold Coil Regulation (0-10V)	-	-	⊙	⊙	⊙	⊙	⊙	⊙	-
4-Pipe Hot & Cold Coil Regulation (0-10V)	-	-	⊙	⊙	⊙	⊙	⊙	⊙	⊙
DX Coil Regulation (0-10V)	-	-	⊙	⊙	⊙	⊙	⊙	⊙	⊙
Electrical Heater Battery Regulation	-	-	●	●	⊙	●	●	●	●
Electrical Pre-Heater Battery Regulation	-	⊙	⊙	⊙	⊙	⊙	⊙	⊙	⊙
Bypass Adjustment									
Manual Bypass Configuration	-	-	-	-	●	●	●	●	●
Automatic Bypass Configuration with free heating/cooling	●	●	-	-	●	●	●	●	●
Night Free Cooling	-	-	-	-	●	●	●	●	●

● = Supplied as standard - = Not available ⊙ = Accessory Required

Functionality	CAD-EPP	SABIK	CAIB/T	UTBS	CAD COMPACT	CADB/T-HE	SLIM	RHE	DUOVENT COMPACT
Security Functions									
Internal Shutoff Damper Actuation	-	-	-	-	-	-	-	-	⊙ (230V)
External Shutoff Damper Actuation	-	-	⊙ (24V)	⊙ (240V)	⊙ (24V)	⊙ (24V)	⊙ (230V)	⊙ (230V)	⊙ (230V)
Filter Monitoring	●	●	●	●	●	●	●	●	●
Alarm Display on User Interface	-	●	●	●	●	●	●	●	●
Detailed Information About Alarms	-	-	●	●	●	●	●	●	●
Fan Fault Monitoring	●	●	●	●	●	●	●	●	●
Communication									
External Control Wiring	●	●	●	●	●	●	●	●	●
External 0-10V Control	●	●	●	●	●	●	●	●	●
Run Relay	-	●(VFC)	●(VFC)	●(24V)	●(VFC)	●(24V)	●(VFC)	●(VFC)	●(VFC)
Alarm/Fault Relay	●(VFC)	-	●(VFC)	●(24V)	●(VFC)	●(24V)	●(VFC)	●(VFC)	●(VFC)
Emergency Fire Shutdown	-	●(VFC)	●(VFC)	●(VFC)	●(VFC)	●(VFC)	●(VFC)	●(VFC)	●(VFC)
Modbus RTU (RS-485)	-	-	●	●	●	●	●	●	●
BACnet TCP/IP	-	-	●	●	-	●	●	●	-
BACnet IP	-	-	-	-	-	-	-	-	-
Mounting Location									
Internal	●	●	●	●	●	●	●	●	●
External	-	-	-	-	-	-	-	-	-

● = Supplied as standard - = Not available ⊙ = Accessory Required

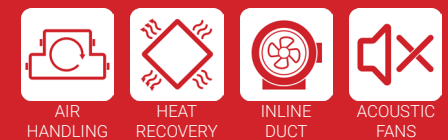



**THE SERVICE YOU WANT,
FROM THE BRAND YOU
CAN TRUST.
Questions? We're Here to Help.**

enquiries.uk@solerpalau.com • www.solerpalau.co.uk • 01473 276890